




NOTE:if used as MONO unit, for the standby control needs, the cross section area of cable connected to L,Lo,N,S must be sufficient for the maximum system current. The maximum system current is equal to the sum of indoor unit and outdoor unit rated current if used as MULTI unit Lo on the terminal block does not need to be connected.

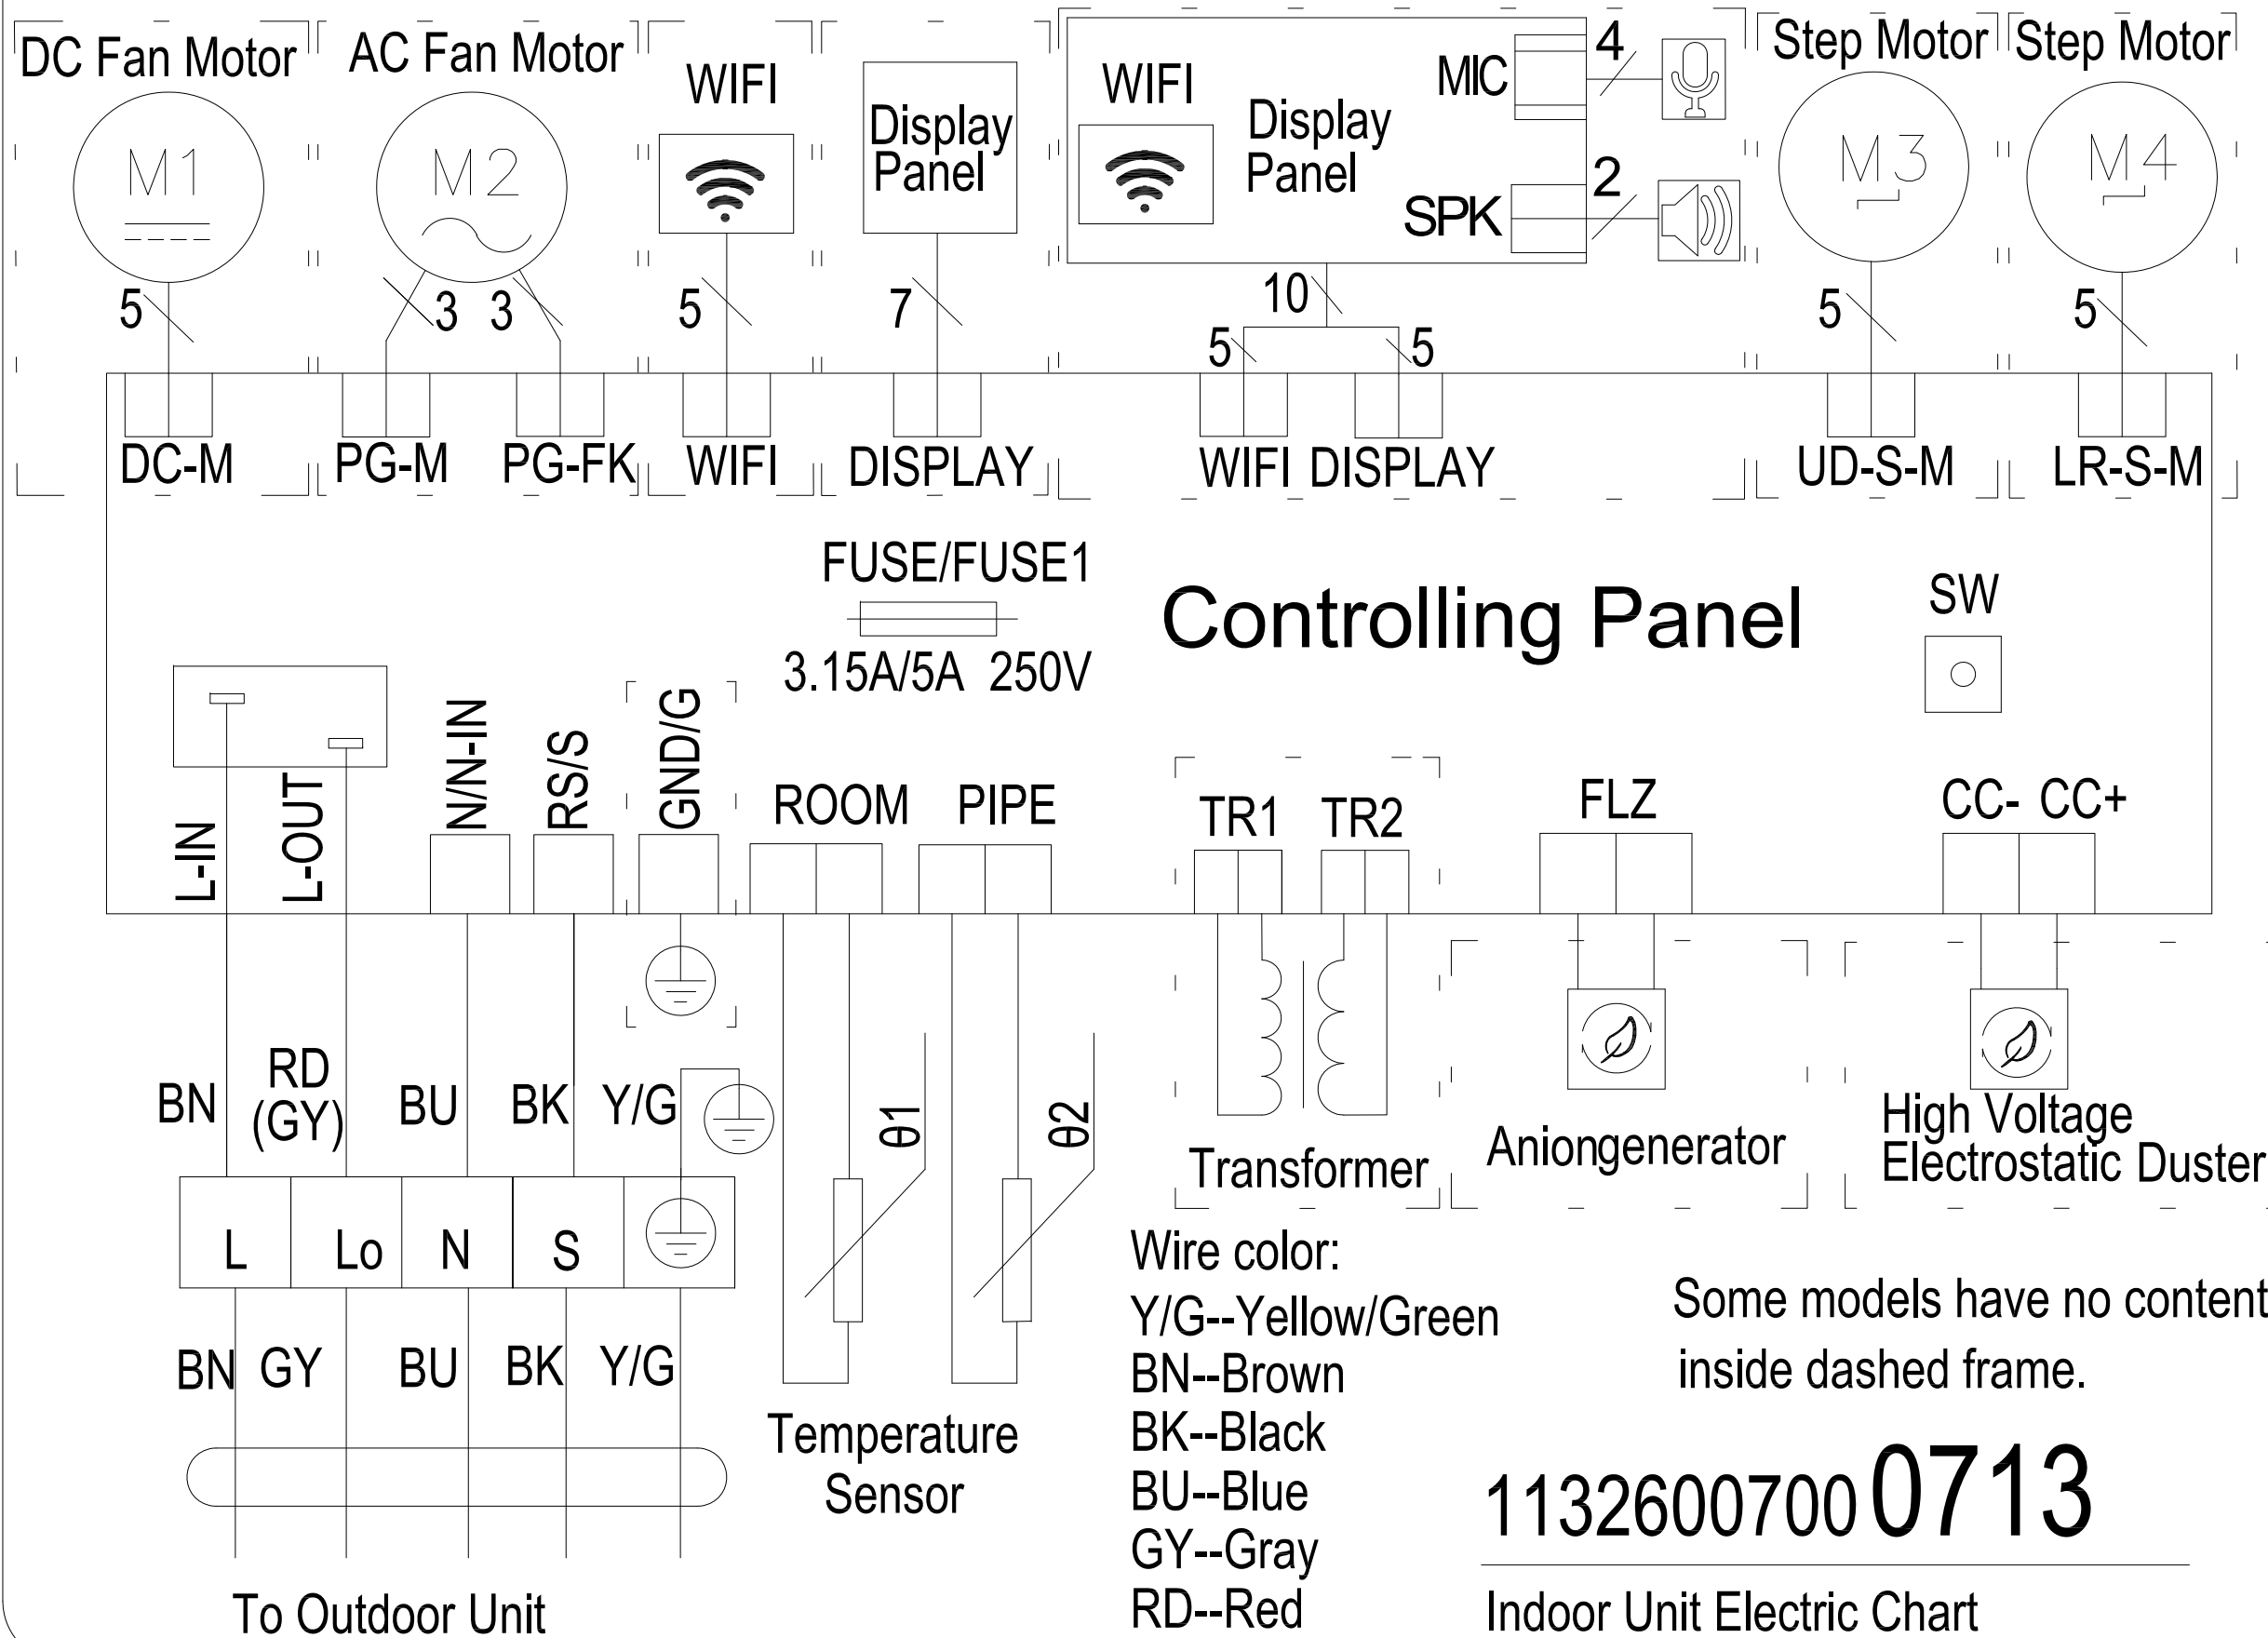

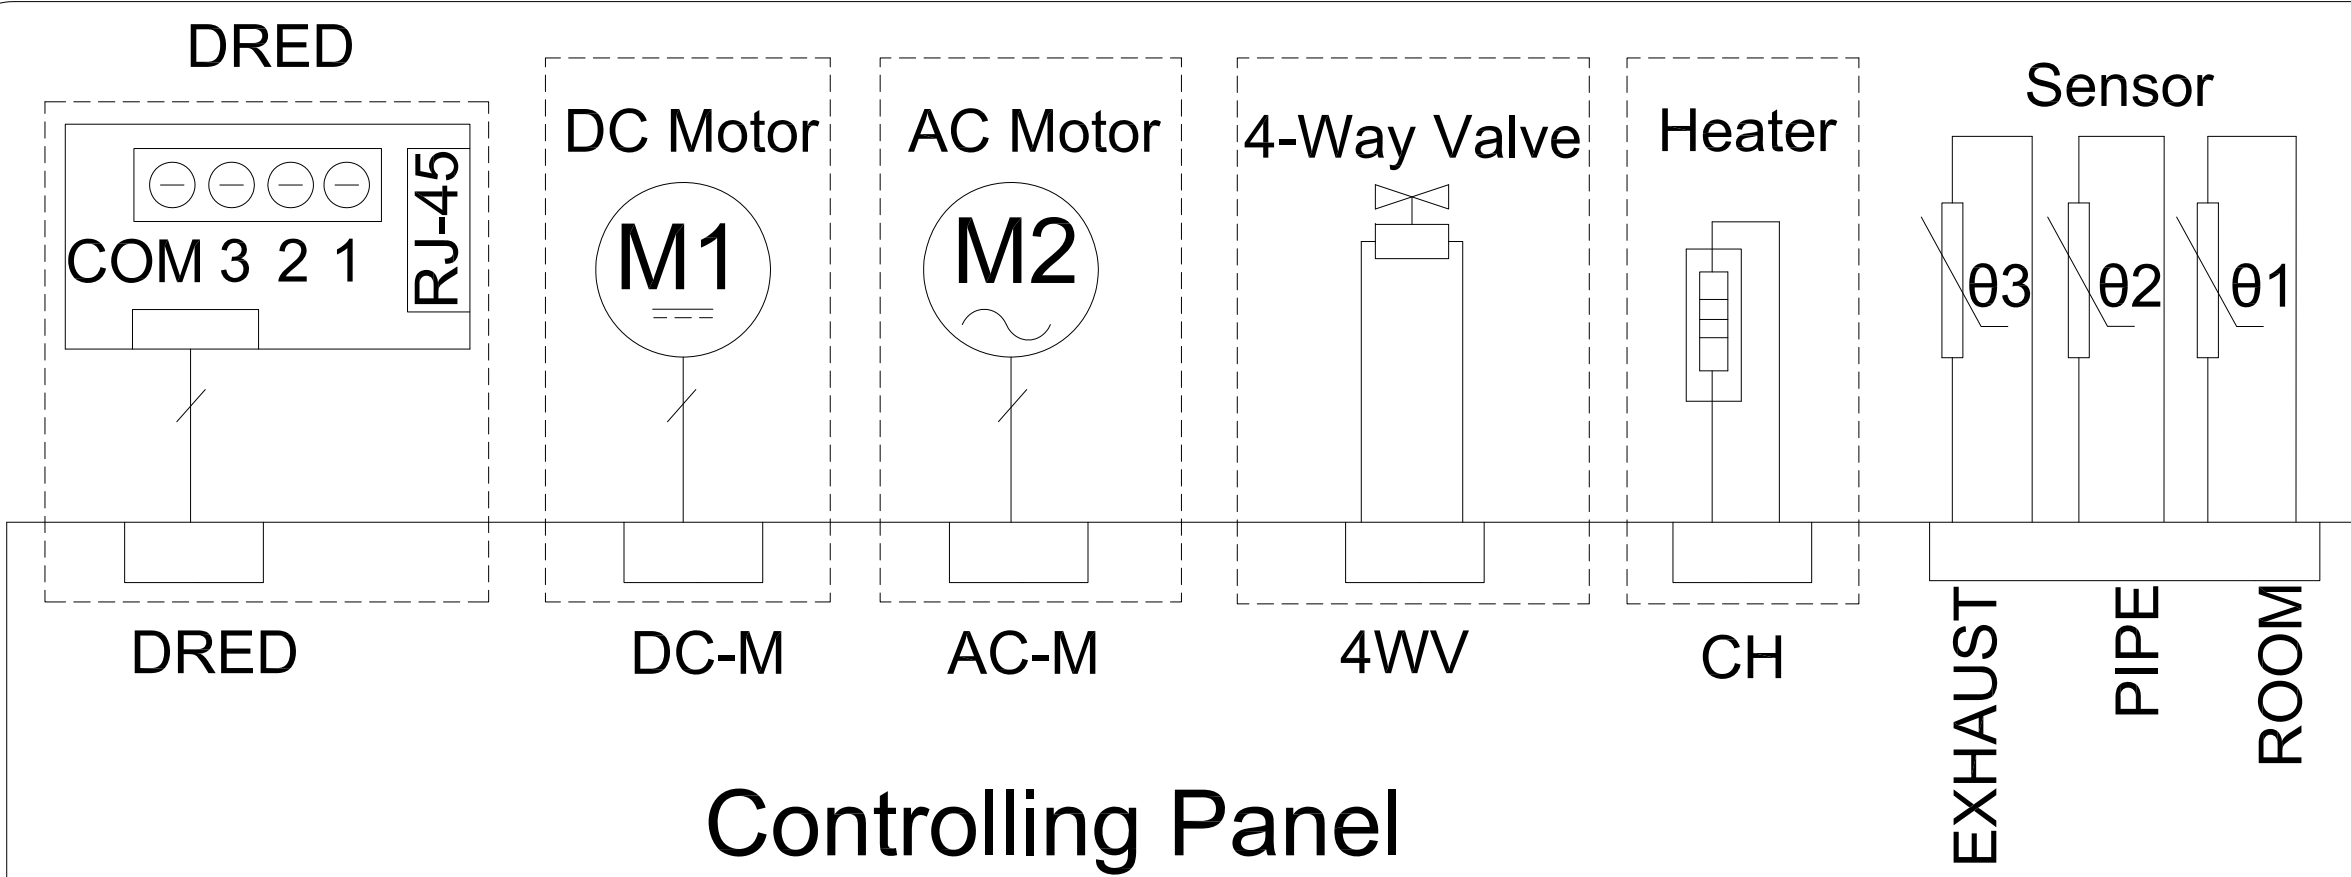

Controlling Panel

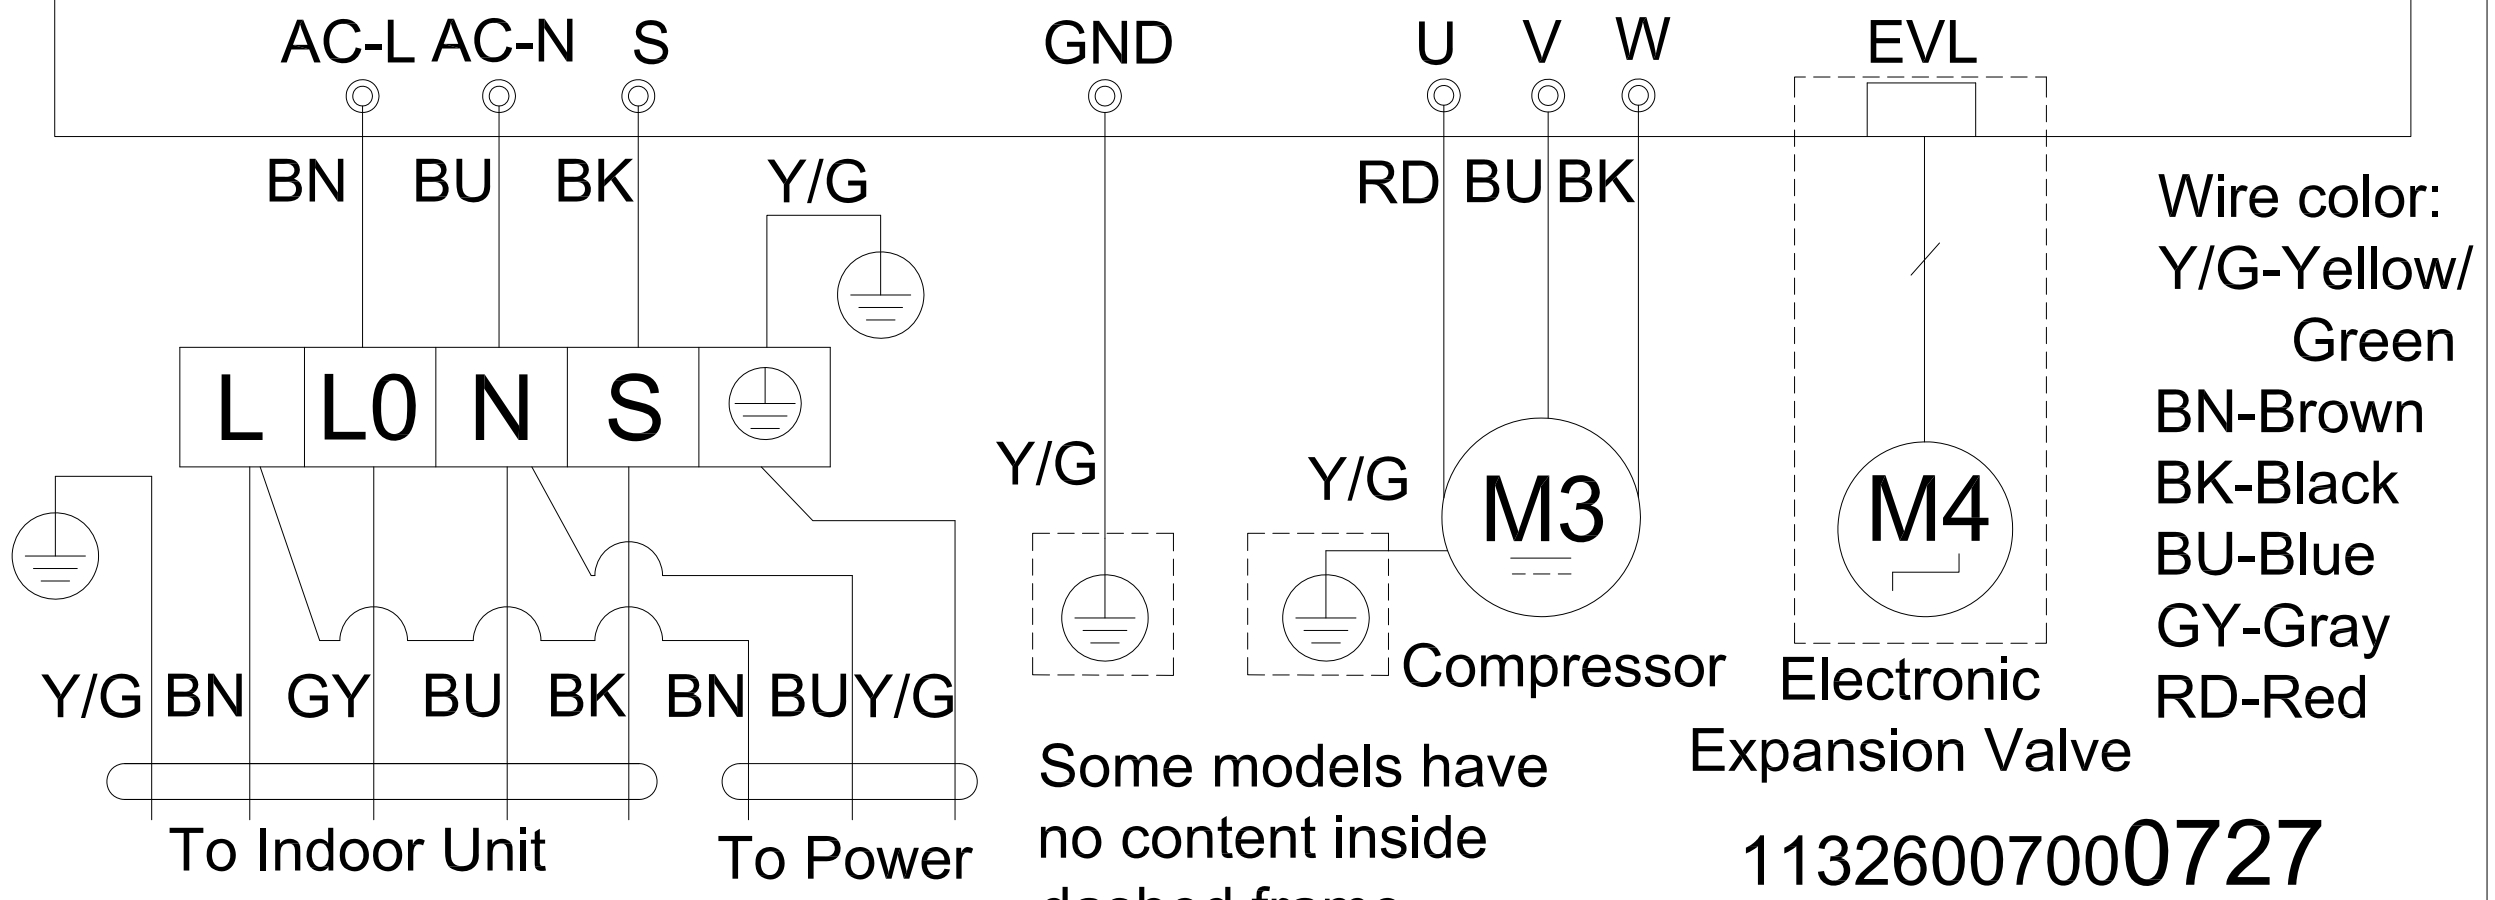

Wire color:
 Y/G-Yellow/
 Green
 BN-Brown
 BK-Black
 BU-Blue
 GY-Gray
 RD-Red

Some models have
 no content inside
 dashed frame.

11326007000727

Outdoor Electrical Wiring Diagram